





ANCHOR BOLT TEMPLATE INFORMATION

| ASSEMBLY PART NO. | TEMPLATE PT. NO. | | ANCHOR BOLTS (12 REQ'D.) | BASE FLANGE SIZE | TOWER BASE SECTION (SEE TOWER ASSY. FOR EXACT FIN) |
|-------------------|------------------|----------|--------------------------|------------------------|--|
| | TOP | BOTTOM | | | |
| 6NAB | (3)VL25T | (3)VL25B | 5/8 X 30" | 5 X 5 X 3/4" | 6N, 7N, 8N, 9N, 9NH |
| 6NABD | (3)VL25T | (3)VL25B | 5/8 X 42" | 5 X 5 X 3/4" | 6N, 7N, 8N, 9N, 9NH |
| 10NAB | (3)VL26T | (3)VL26B | 3/4 X 36" | 6 X 6 X 3/4" | 10N, 10NH |
| 10NABD | (3)VL26T | (3)VL26B | 3/4 X 48" | 6 X 6 X 3/4" | 10N, 10NH |
| 11NAB | (3)VL27T | (3)VL27B | 7/8 X 42" | 7 X 7 X 1/2" | 11N, 12N, 12NH, 13N, 13NH |
| 11NABD | (3)VL27T | (3)VL27B | 7/8 X 60" | 7 X 7 X 1/2" | 11N, 12N, 12NH, 13N, 13NH |
| 14NAB | (3)VL28T | (3)VL28B | 1 X 48" | 9 1/2 X 9 1/2 X 1 1/4" | 14N, 14NH, 15N, 16N |
| 15NHAB | (3)VL28T | (3)VL28B | 1 X 72" | 9 1/2 X 9 1/2 X 1 1/4" | 15NH, 16NH |
| 15NHABD | (3)VL28T | (3)VL28B | 1 X 78" | 9 1/2 X 9 1/2 X 1 1/4" | 14N, 14NH, 15N, 15NH, 16N, 16NH |

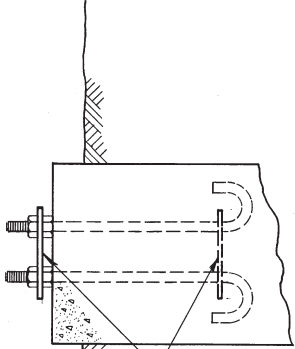

ANCHOR BOLT SETTING TEMPLATES (SEE CHART FOR PART NO. REQ'D.) REMOVE UPPER TEMPLATE BEFORE INSTALLING TOWER.

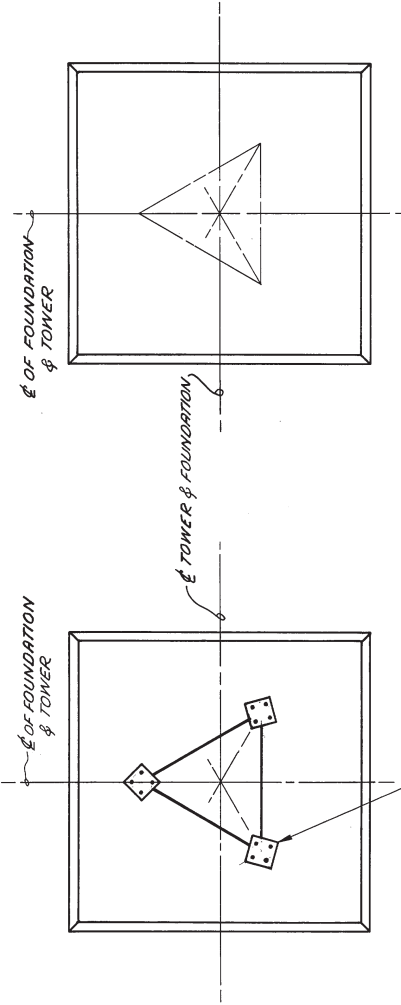

NOTES

1. IT IS THE RESPONSIBILITY OF THE FOUNDATION CONTRACTOR TO VERIFY THAT THE CORRECT SETTING TEMPLATE & FOUNDATION DWG. ARE BEING USED.
2. CHECK ANCHOR BOLT SIZE, NO., SPACING, & BOLT CIRCLE DIA. ON TEMPLATE AGAINST ANCHOR BOLT LAYOUT DRAWINGS BEFORE INSTALLATION.
3. BOLT TEMPLATES AVAILABLE FOR SECTIONS 6N THRU 16N OR 16NH.
4. ALLOW FOR DRAINAGE OF ALL PIPE LEG TOWER SECTIONS.
5. PART NO. 1N CHART AT UPPER LEFT CONSISTS OF 12 ANCHOR BOLTS & 6 TEMPLATES.

ALL WELDED 'SB' ASS'Y. FOR SECTIONS 2N, 3NH, 4N, & 5N PT. NOS. SB2, SB3, SB4, & SB5

INDEPENDENT ANCHOR BOLTS (SEE TOWER ASSY FOR LAYOUT INFO.)

PAD FOUNDATION FOR SECTIONS 1W-10N 7N THRU 16N OR 16NH

| | | | | |
|-----|----------------------------------|-------------|------|----|
| NO. | | DESCRIPTION | DATE | BY |
| R3 | ADDED 'D' ABS & REVISED PAD FDM. | 3-17-88 | VHD | |
| R2 | RE-DRAWN (REPLACES CU-730104R1) | 2-14-75 | DAK | |

ROHN MANUFACTURING
DIVISION OF

TITLE: ANCHOR BOLT SETTING TEMPLATE INFORMATION & SHORT BASE DETAILS

THIS DRAWING IS THE PROPERTY OF ROHN. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT OUR WRITTEN CONSENT.

SCALE: MATERIAL: FINISH: WT.

DATE: 2-18-75
DRAWN BY: DAK
CHECKED BY: VHD
DATE: 1-75
DATE: 7-75

FILE NO. CU 730104 R3

PRINTED IN U.S.A.

NOTE: SEE DWG. NO. B 740793 FOR TEMPLATE FABRICATION DETAILS.