



BILL OF MATERIAL

ITEM	QTY	PART NO	DESCRIPTION	DWG NO
1	1	SEE ASSY P/N	MOUNTING PIPE OR TUBE	N/A
2	2	FY206	MOUNTING ANGLE 1-1/2 X 1-1/2 X 1/2GA.	A950180
3	2	D114	SADDLE CLAMP	N/A
4	4	FJR42	U-BOLT	N/A
5	4	S180771	5/16 X 2-1/2 BOLT	N/A

ASSY P/N: DDM150 (TUBE 1-1/2")
(TUBE 1.5" O.D. X 3' LG.)
(P/N FY207)




ASSY P/N: DDM166 (PIPE 1-1/4")
(PIPE 1.66" O.D. X 3' LG.)
(P/N FY208)

ASSY P/N: DDM238 (PIPE 2")
(PIPE 2.375" O.D. X 3' LG.)
(P/N FY209)

NOTE: OUTSTANDING LEG OF TOWER HAS BEEN OMITTED FOR CLARITY.

NOTE: MOUNTING ANGLE MUST BE MOUNTED AS CLOSE TO LEG/BRACE INTERSECTION AS POSSIBLE.

TOTAL TOWER LOAD MUST NOT EXCEED CAPACITY OF 256 TOWER.

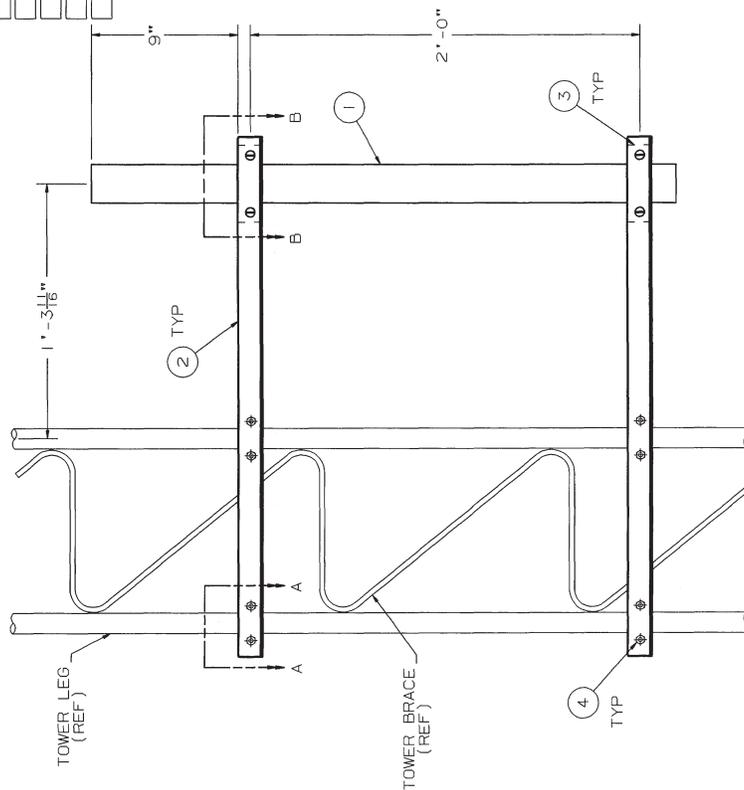

UNR - ROHN
Division of UNR, Inc.

Title
DBS MODEL -
TOWER DISH MOUNT

Scale: NONE
Unless otherwise specified, dimensions are given in inches. Tolerances are as noted.

Drawn by: SDM Date: 7-18-95
Checked by: MD Date: 8-11-95
Approved by Engineering: Date:
Approved by Production: Date:
Approved by Sales: Date: 8-22-95

File Number: EF40395M
Drawing Number: C950130R1
Drawing Type: CATALOG